

A

B

C

D

1

2

3

4

5



6

A

B


C

D

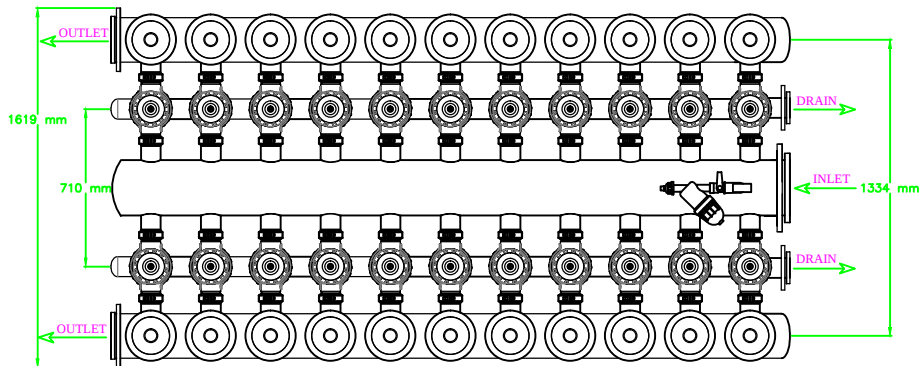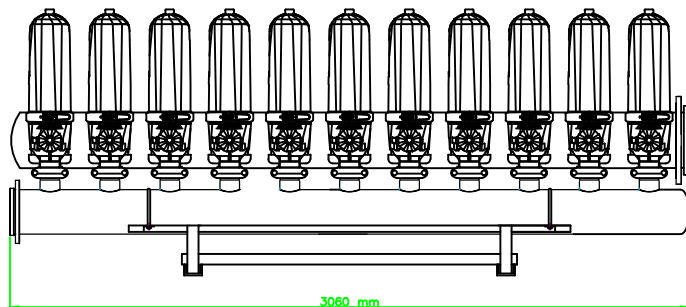

NOTES:

1. PIPING MATERIAL:HDPE , Carbon steel st, 304.
2. CONNECTION TYPE: ANSI 150# FLANGE.
3. MANUAL VALVES SHALL BE INSTALLED AT THE INLET AND OUTLET OF THE DISC FILTER.
4. THE DRAIN PIPE SHALL BE CONNECTED TO THE DRAINAGE SYSTEM.
5. POWER SUPPLY: 220V/1PHASE/50HZ.
6. CONCRETE FOUNDATION (HEIGHT: 200MM)
- 7.AND EXPANSION ANCHOR BOLTS ARE SUGGESTED FOR SITE INSTALLATION.

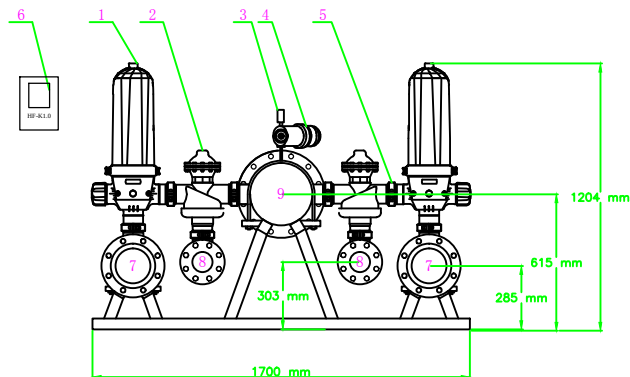

9		Inlet Pipe 10"	1			
8		Drain Pipe 3"	2			
7		Outlet Pipe 8"	2			
6		HF-K1.0 Controller	2			
5		Couplings	88	Carbon steel st		
4		Water Source Filter	1	Reinforced Polyamide		
3		Pressure Gauge	2	SS304		
2		Backwash Valve	22	Reinforced Polyamide		
1		Disc Filter Unit	22	Reinforced Polyamide		
NO.		Description	Quantity	Spec. & Material	Weight	

								Beijing Haiiao Technologies Co.,ltd				
标记	处数	分区	更改文件号	签名	DATE			HF-A3-22-10 DISCFILTER	MATERIAL	QUANTITY	WEIGHT	SCALE
R	内部评审版							DWG NO	/	1		1:
A	初步设计							HF-A03-22-00-01	SHEET OF			
REV	DESCRIPTION	DESD	DATE	APPD	DATE	APPD	DATE					

4

5

6